



GO NO. 07704	S/A NO. 44650	PAGE 1 OF 8	TOTAL PAGES 3	REV LTR/CHG NO SEE SUMMARY OF CHG NC	NUMBER N704TI990036
-----------------	------------------	----------------	------------------	--------------------------------------------	------------------------

PROGRAM TITLE
Decontamination and Disposition of Facilities

DOCUMENT TITLE
Radiological Survey Results - Release to Unrestricted Use, SRE Region X

DOCUMENT TYPE Technical Information	KEY NOUNS Decontamination
----------------------------------------	------------------------------

ORIGINAL ISSUE DATE	REL. DATE 5-31-83 PC	APPROVALS	DATE
---------------------	-------------------------	-----------	------

PREPARED BY/DATE J. H. Wallace	DEPT 779	MAIL ADDR T034	APPROVALS R. J. Tuttle 1/27/83 B. F. Ureda 5/4/83 C. C. Conners 5/5/83 J. M. Marzec W. R. McCurnin 5/17/83 for WRMCC M. E. Remley 18 May 83
-----------------------------------	-------------	-------------------	---------------------------------------------------------------------------------------------------------------------------------------------------------------

IR&D PROGRAM? YES NO
IF YES, ENTER TPA NO.

DISTRIBUTION		
*	NAME	MAIL ADDR

- | | | |
|---|----------------|------|
| * | C. C. Conners | NB02 |
| * | J. M. Harris | T055 |
| * | J. M. Marzec | T143 |
| * | W. R. McCurnin | T020 |
| * | M. E. Remley | NB13 |
| * | R. J. Tuttle | NB13 |
| * | B. F. Ureda | NB02 |
| * | J. H. Wallace | T034 |

ABSTRACT

The results of the radiological survey for Region X of the SRE facility are described. All survey results are below the applicable limits, indicating that this area may be released for unrestricted use.

"CLEARED FOR PUBLIC RELEASE BY DOE PATENT COUNSEL NOVEMBER 2011"

RESERVED FOR PROPRIETARY/LEGAL NOTICES

THIS REPORT MAY NOT BE PUBLISHED WITHOUT THE APPROVAL OF THE DOE OFFICE OF PATENT COUNSEL

This report was prepared as an account of work sponsored by the United States Government. Neither the United States nor the United States Department of Energy, nor any of their employees, nor any of their contractors, subcontractors, or their employees, makes any warranty, express or implied, or assumes any legal liability or responsibility for the accuracy, completeness or usefulness of any information, apparatus, product or process disclosed, or represents that its use would not infringe privately owned rights.

0059Y/req

* COMPLETE DOCUMENT
NO ASTERISK, TITLE PAGE/SUMMARY OF CHANGE PAGE ONLY



CONTENTS

	Page
1.0 Introduction.....	3
2.0 Surveys and Results.....	7
3.0 Conclusions.....	8

TABLES

1. Contamination/Radiation Limits.....	5
2. Survey Measurement Requirements.....	6

FIGURES

1. SRE Facility.....	4
----------------------	---



1.0 INTRODUCTION

This document covers Region X of the SRE facility (Figure 1). This area is now in use as a parking lot and/or storage area and includes the natural ground to the east of Building 143.

Radiological surveys were performed in conformance with N704TP990008, "Radiological Survey Plan Support of D/D Operations at T-143 (SRE)", R. K. Owens.

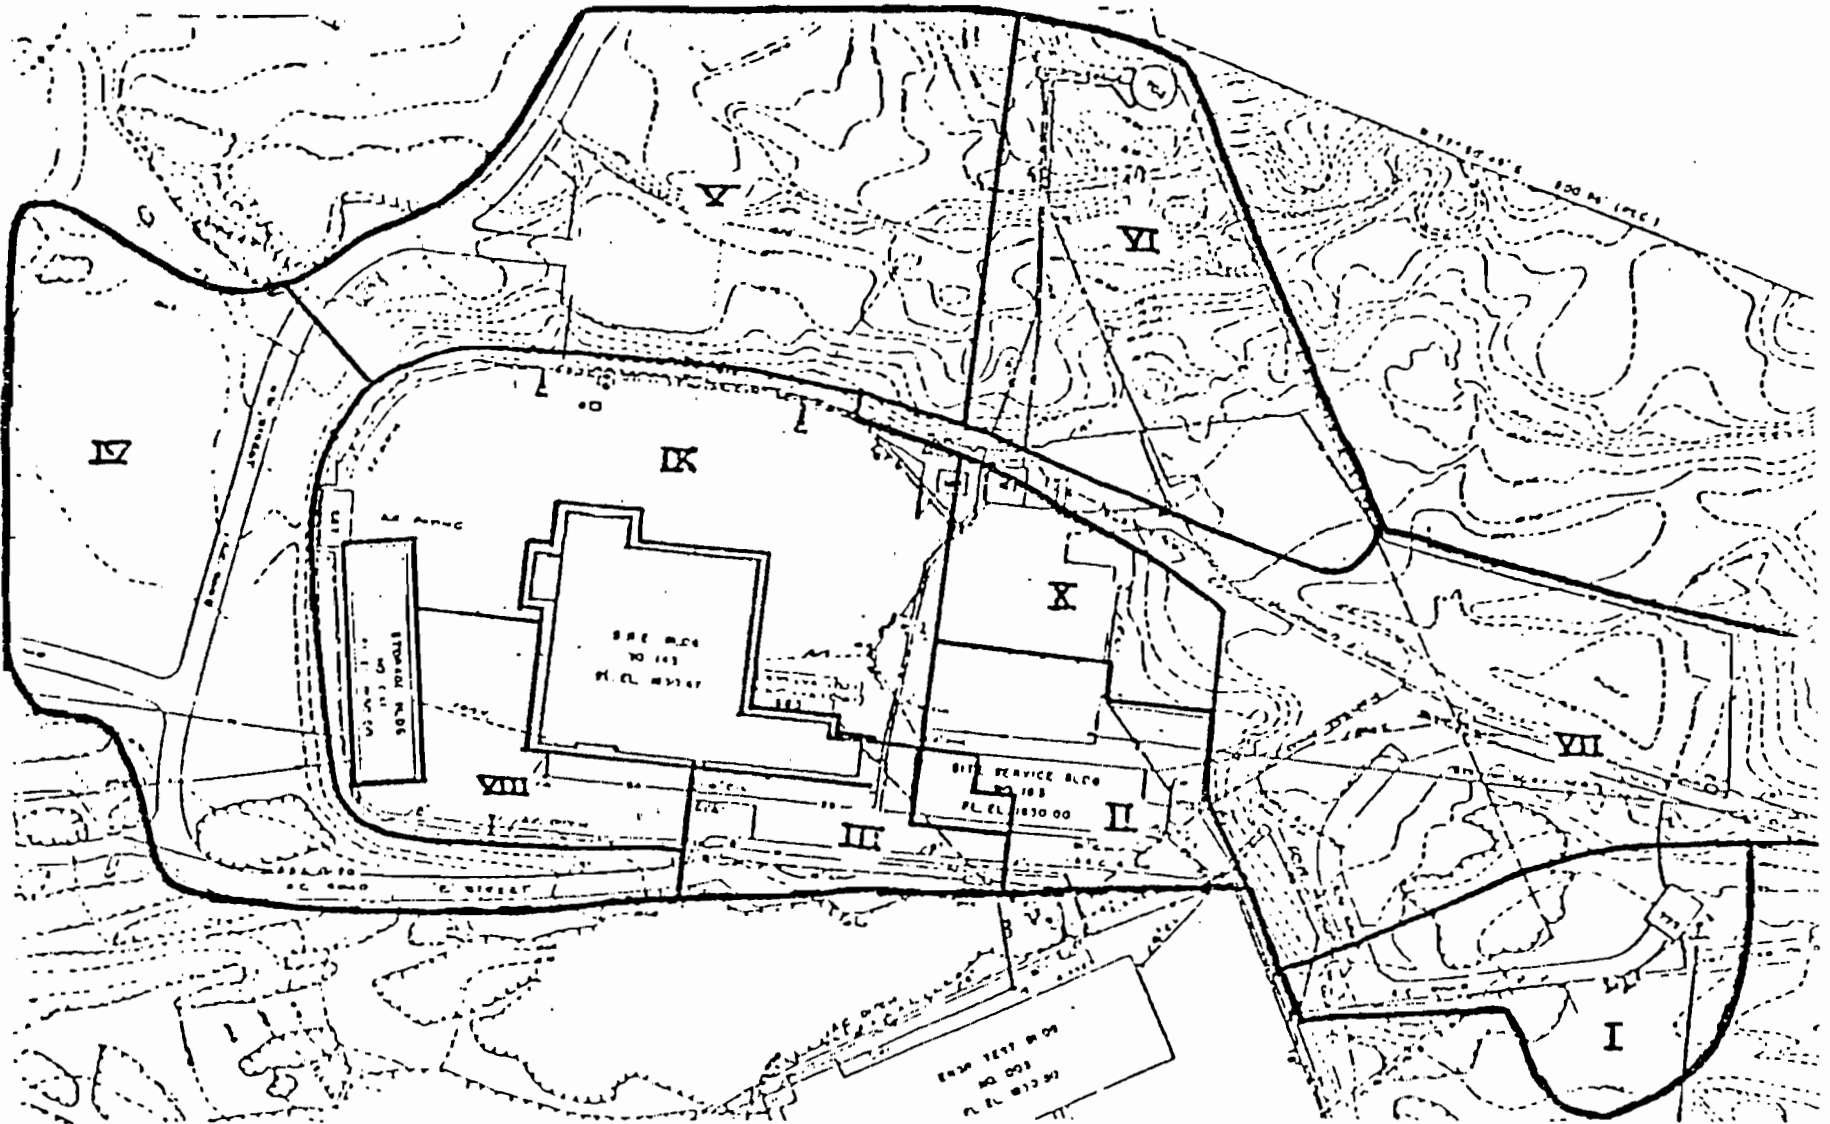


FIGURE 1
SRE FACILITY



The contamination/radiation limits for unrestricted use that were applied in decontaminating this area are shown in Table 1 and the requirements for survey measurements in each region are shown in Table 2.

TABLE 1
RESIDUAL RADIOACTIVITY LIMITS
FOR RELEASE FOR UNRESTRICTED USE

	Total	Removal
<u>Surfaces</u>		
Alpha	100 dpm/100 cm ²	20 dpm/100 cm ²
Beta	0.1 mrad/hr at 1 cm through 7 mg/cm ² absorber	100 dpm/100 cm ²
<u>Soil</u>	100 pCi/g gross detectable beta	

TABLE 2
SURVEY MEASUREMENT REQUIREMENTS

Region	Removable Contamination	Surface Radiation	Soil Samples	Concrete Samples	Water Samples
I	X	X	X	X	X
II	X	X	X		
III		X			
IV	X	X	X		
V		X	X	X	
VI		X	X		
VII		X	X		X
VIII		X			
IX	X	X	X		
X	X	X	X		
041	X	X			
163	X	X			
143 Offices	X	X			
143 High Bay	X	X	X	X	X

Measurements of removable contamination are omitted from those areas that consist solely of soil or asphalt-paved surfaces.



2.0 SURVEYS AND RESULTS

A. REMOVABLE CONTAMINATION

Smear surveys for this region were not applicable and were replaced by soil sampling.

B. SURFACE RADIATION

For this part of the survey, a Ludlum Model 12S Micro-R meter was used. An average reading of 10 μ R/h was recorded for this region. No readings differed significantly from background.

C. SOIL SAMPLES

Twenty-five soil samples were processed for this region, all below 30 pCi/g gross detectable beta. All soil samples were counted on a Nuclear Measurements Corporation automatic counting system with a KCl standard with an efficiency factor of 3.2 and a background of 25.6 cpm.

The maximum soil activity found was 28 pCi/g with an average of 25 pCi/g.



3.0 CONCLUSIONS

In each type of test performed, all samples indicated levels less than those limits prescribed by the Decontamination and Disposition of Facilities Program for release for unrestricted use.

All appropriate surveys indicate that current existing radioactivity in the area is below the applicable limits for release for unrestricted use.